

MINIMUM 3-2x4 STUD SPF No. 2 COLUMNS WITH MIN. 2-20ga STRAPS FASTENED WITH MINIMUM 10-EACH No 10 SCREWS EACH END OF EACH STRAP.

SCHEDULE \ LEGEND

KEY	ITEM DESCRIPTION	SIZE	ROUGH OPENING
SC	36" X 80" STEELCRAFT W/ 10X10 PANE	36X80	40 1/2" X 82 1/2"
M	36" X 80" MOHAWK - HOLLOW CORE	36X80	37 1/4" X 81"
H	80" X 24" H-R - H.S BRONZE/CLEAR	60X24	60" X 24 1/2" UP 55 1/2"

SW = SHEARWALL (REF. AMTEX DESIGN MANUAL; SECTION 03.000 FOR FASTENING)

COLORS:

EXT. SIDING: LIGHT STONE EXT. TRIM: LIGHT STONE



NOTE:
R-11 UNFACED INSULATION IN PARTITION WALL. (FULL HT.)

Texas Industrialized Building Code Council
IBC IRC

SEP 26 2005

Approved
PFS Corp.
IHDRA 7

JOE STEEDE, P.E.
13998 GOLDMARK, SUITE 374
DALLAS, TX 75250 PHONE: (972) 238-1611

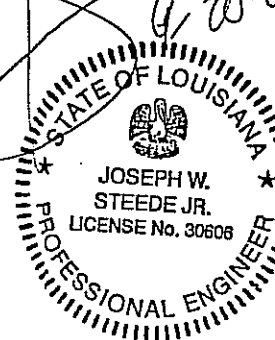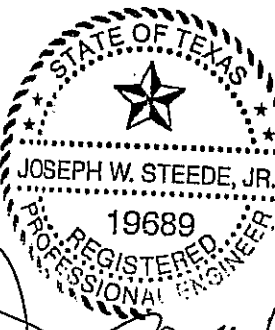

LTR	REVISION	BY	DATE	DRAWN BY: M.L.S.	PROJECT: AMTEX STOCK	TITLE: FLOOR PLAN		832 EAST WALNUT GARLAND, TX 75040 (972) 278-7828 FAX: (972) 276-5105 Email: engineering@amtexcorp.com
				DATE: 8/31/05	SCALE: 3/16"=1'-0"	DWG. NO. T2468D-3		